




HILTI HUS4-H Screw Anchor

MFPA Fire Assessment

GS 6.1/21-041-3 (29.06.2022)



MFPA Leipzig GmbH

Leipzig Institute for Materials
Research and Testing

Testing, Inspection and
Certification Authority for
Construction Products and
Construction Types

Business Division VI: Center for In-
novation and Calculation

Head of Division:
Dr.-Ing. Susanne Reichel
Tel.: +49 (0) 341-6582-106
Fax: +49 (0) 341-6582-135
s.reichel@mfpa-leipzig.de

Work Group 6.1
FEM

Contact Person:
Dr.-Ing. Susanne Reichel
Tel.: +49 (0) 341-6582-106
s.reichel@mfpa-leipzig.de

Advisory Opinion No. GS 6.1/21-041-3

29.06.2022

Translation of the original German document GS 6.1/21-041-3

Object: Assessment of the load bearing behaviour of Hilti screw anchors HUS4-H 8 and HUS4-H 10 under tension load and one-sided fire loading according to the standard temperature-time curve for anchoring in prestressed concrete hollow core slabs - abbreviated version

Client: **Hilti Aktiengesellschaft**
Feldkircherstrasse 100
9494 Schaan
Liechtenstein

Prepared by: Dr.-Ing. Susanne Reichel

This document covers 9 pages, including 0 appendices.

This document may only be reproduced in its unabbreviated form. All publications, even in excerpts, requires the prior written permission of MFPA Leipzig GmbH. The legal binding form is the written German form with the original signatures and original stamp of the authorized signatory / signatories. General terms and conditions of MFPA Leipzig GmbH are valid.



Contents

1 Objective and request	3
2 Description of the construction	4
3 References	6
3.1 Utilized guidelines, rules and standards	6
3.2 Reference documents	6
3.2.1 ETAs and verifications of applicability	6
3.2.2 Assessment and test reports	6
4 Assessment of the performance	7
4.1 Design concept	7
4.2 Load bearing capacity in case of fire	7
5 Special notes	8
6 Signatures	9

1 Objective and request

MFPA Leipzig GmbH was ordered by Hilti AG to assess the load bearing behaviour of Hilti screw anchors HUS3 and HUS4 under tension load and one-sided fire loading according to the standard temperature-time curve (STTC, see [N1]) for anchoring in prestressed concrete hollow core slabs. The document at hand summarizes the design concept and the corresponding characteristic load bearing capacities for Hilti screw anchors HUS4-H 8 and HUS4-H 10. For the detailed derivation of the values, please see [G1].

2 Description of the construction

The Hilti screw anchor HUS4 is an anchor made of galvanized steel, produced in sizes 8, 10, 12, 14 and 16. The anchor is screwed into a pre-drilled cylindrical drill hole, with the special thread cutting an internal thread into the anchoring base during the setting process. Anchoring is achieved by mechanical interlock of the special thread. With [P2], a current European Technical Assessment is available for Hilti screw anchors HUS4.

The Hilti screw anchor HUS4 is offered in the following head types

- -H: hexagonal head,
- -A: external thread,
- -C: countersunk head,

The advisory opinion at hand covers Hilti screw anchors HUS4-H with hexagonal head.

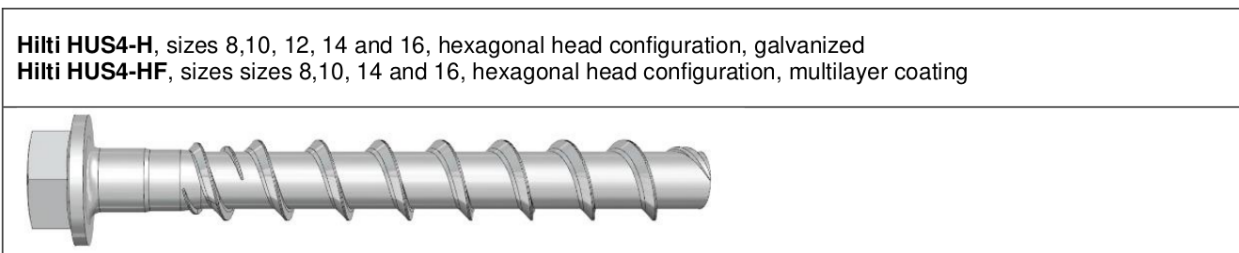


Figure 1: Hilti screw anchor HUS4-H, from [P2]

The on-site geometry of Hilti screw anchors HUS4-H is specified in Figure 2 (from [P2]).

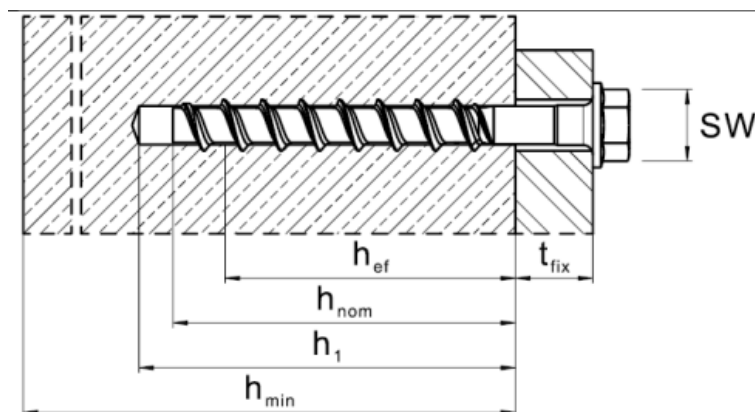


Figure 2: Hilti screw anchor HUS4-H: On-site geometry, from [P2]

Für jede Schraubengröße sind 3 verschiedene nominelle Einbindetiefen vorgesehen. Um zudem eine große Spanne an Anbauteildicken t_{fix} realisieren zu können, sind die Hilti Betonschrauben HUS4 in verschiedenen Längen verfügbar.

Three different nominal embedment depths are provided for each screw size. In order to realize a wide range of attachment thicknesses t_{fix} , additionally, Hilti screw anchors HUS4 are available in different lengths.

In connection with the performance characteristics in case of fire for anchoring in prestressed concrete hollow core slabs, the screw anchors

- HUS4-H 8 and
- HUS4-H 10

are investigated.

3 References

3.1 Utilized guidelines, rules and standards

The analyses are based on the following guidelines, rules and standards:

- [N1] DIN EN 1363-1:2020-05: Fire resistance tests - Part 1: General requirements; German version EN 1363-1:2020
- [N2] DIN EN 1992-4:2019-04: Eurocode 2 - Design of concrete structures - Part 4: Design of fastenings for use in concrete; German version EN 1992-4:2018
- [N3] DIN EN 206:2017-01: Concrete - Specification, performance, production and conformity; German version EN 206:2013+A1:2016
- [N4] DIN EN 1992-1-2:2010-12: Eurocode 2: Design of concrete structures - Part 1-2: General rules - Structural fire design; German version EN 1992-1-2:2004 + AC:2008

3.2 Reference documents

The analyses are based on the following additional documents:

3.2.1 ETAs and verifications of applicability

- [P2] ETA-20/0867: Hilti concrete screw HUS4, Mechanical fastener for use in concrete – Deutsches Institut für Bautechnik, 14.04.2022

3.2.2 Assessment and test reports

- [G1] Gutachterliche Stellungnahme Nr. GS 6.1/21-041-1: Bewertung des Tragverhaltens von Hilti Betonschrauben HUS3 und HUS4 unter zentrischem Zug und einseitiger Brandbeanspruchung gemäß Einheitstemperaturzeitkurve bei Verankerung in Spannbetonhohldielen – MFPA Leipzig GmbH; 21.06.2022

4 Assessment of the performance

4.1 Design concept

The characteristic load bearing capacity of a fastener under centric tensile loading in case of fire shall be determined from the minimum value of the load bearing capacity for steel failure, pull-out failure and concrete cone failure

$$N_{Rk,fi}(t) = \min [N_{Rk,s,fi}(t), N_{Rk,p,fi}(t), N_{Rk,c,fi}(t)] . \quad (1)$$

In connection with the failure mode concrete cone failure, the load bearing capacity $N_{Rk,c,fi}^0(t)$ [kN] for concrete cone failure of a single fastener is determined below. The characteristic load bearing capacity $N_{Rk,c,fi}$ to be considered in the framework of the design has to be determined for each specific construction capturing the influences of neighbouring anchors and the edge distance. In this context, reference is given to [N2], Chapter 7.2.1.4 and Appendix D.4.2.2.

4.2 Load bearing capacity in case of fire

The characteristic load bearing capacity of a single screw HUS4-H 8 and HUS4-H 10 in case of fire is specified in

Table 1.

screw	$N_{Rk,fi}(t)$ [kN]			
	30min	60min	90min	120min
$h \geq 265mm, h_1 \geq 35mm, h_{ef} \geq 35mm$				
HUS4-H 8	0,260	0,260	0,260	0,260
HUS4-H 10	0,600	0,600	0,600	0,600
$h \geq 380mm, h_1 \geq 40mm, h_{ef} \geq 40mm$				
HUS4-H 8	0,761	0,761	0,761	0,609
HUS4-H 10	0,800	0,800	0,800	0,800

Table 1: Hilti screw anchors HUS4-H 8 and HUS4-H 10 for anchoring in prestressed concrete hollow core slabs: Characteristic load bearing capacity $N_{Rk,fi}(t)$ [kN] of a single screw (h : cross section height, h_1 : concrete thickness below the hollows, h_{ef} : embedment depth)

5 Special notes

The advisory opinion at hand is valid for Hilti screw anchors HUS4-H in combination with prestressed concrete hollow core slabs which are installed according to the manufacturer's instructions.

The load bearing capacities specified in the framework of the document at hand are determined for one-sided fire loading according to the standard temperature-time curve and are valid exclusively for this thermal loading.

The load bearing capacities specified in the framework of the document at hand are determined for central tensile loading in the screw anchor's longitudinal direction. Following [N2], on the safe side, a transfer to steel failure is possible for tensile loads perpendicular and oblique to the anchor axis.

The load bearing capacity values shown in this document do not apply to the failure modes of the substrate under tensile loads perpendicular and oblique to the anchor axis.


The assessment at hand is valid for prestressed concrete hollow core slabs which exhibit the strength class $\geq C20/25$ and $\leq C50/60$ according to [N3]. Proof of the adequate fire resistance of the prestressed concrete hollow core slabs is to be provided separately.

The load bearing capacities specified in the framework of the document at hand are determined assuming that no explosive concrete spalling occurs and are only valid under this condition. Evidence on the prevention of explosive concrete spalling is given in [N4], Chapter 4.5.

6 Signatures

This document does not replace a certificate of constancy of performance or suitability according to national and European building codes.

Leipzig, 29.06.2022

A handwritten signature in blue ink, appearing to read 'S. Reichel', written over a horizontal line.

Dr.-Ing. S. Reichel
Head of Business Division